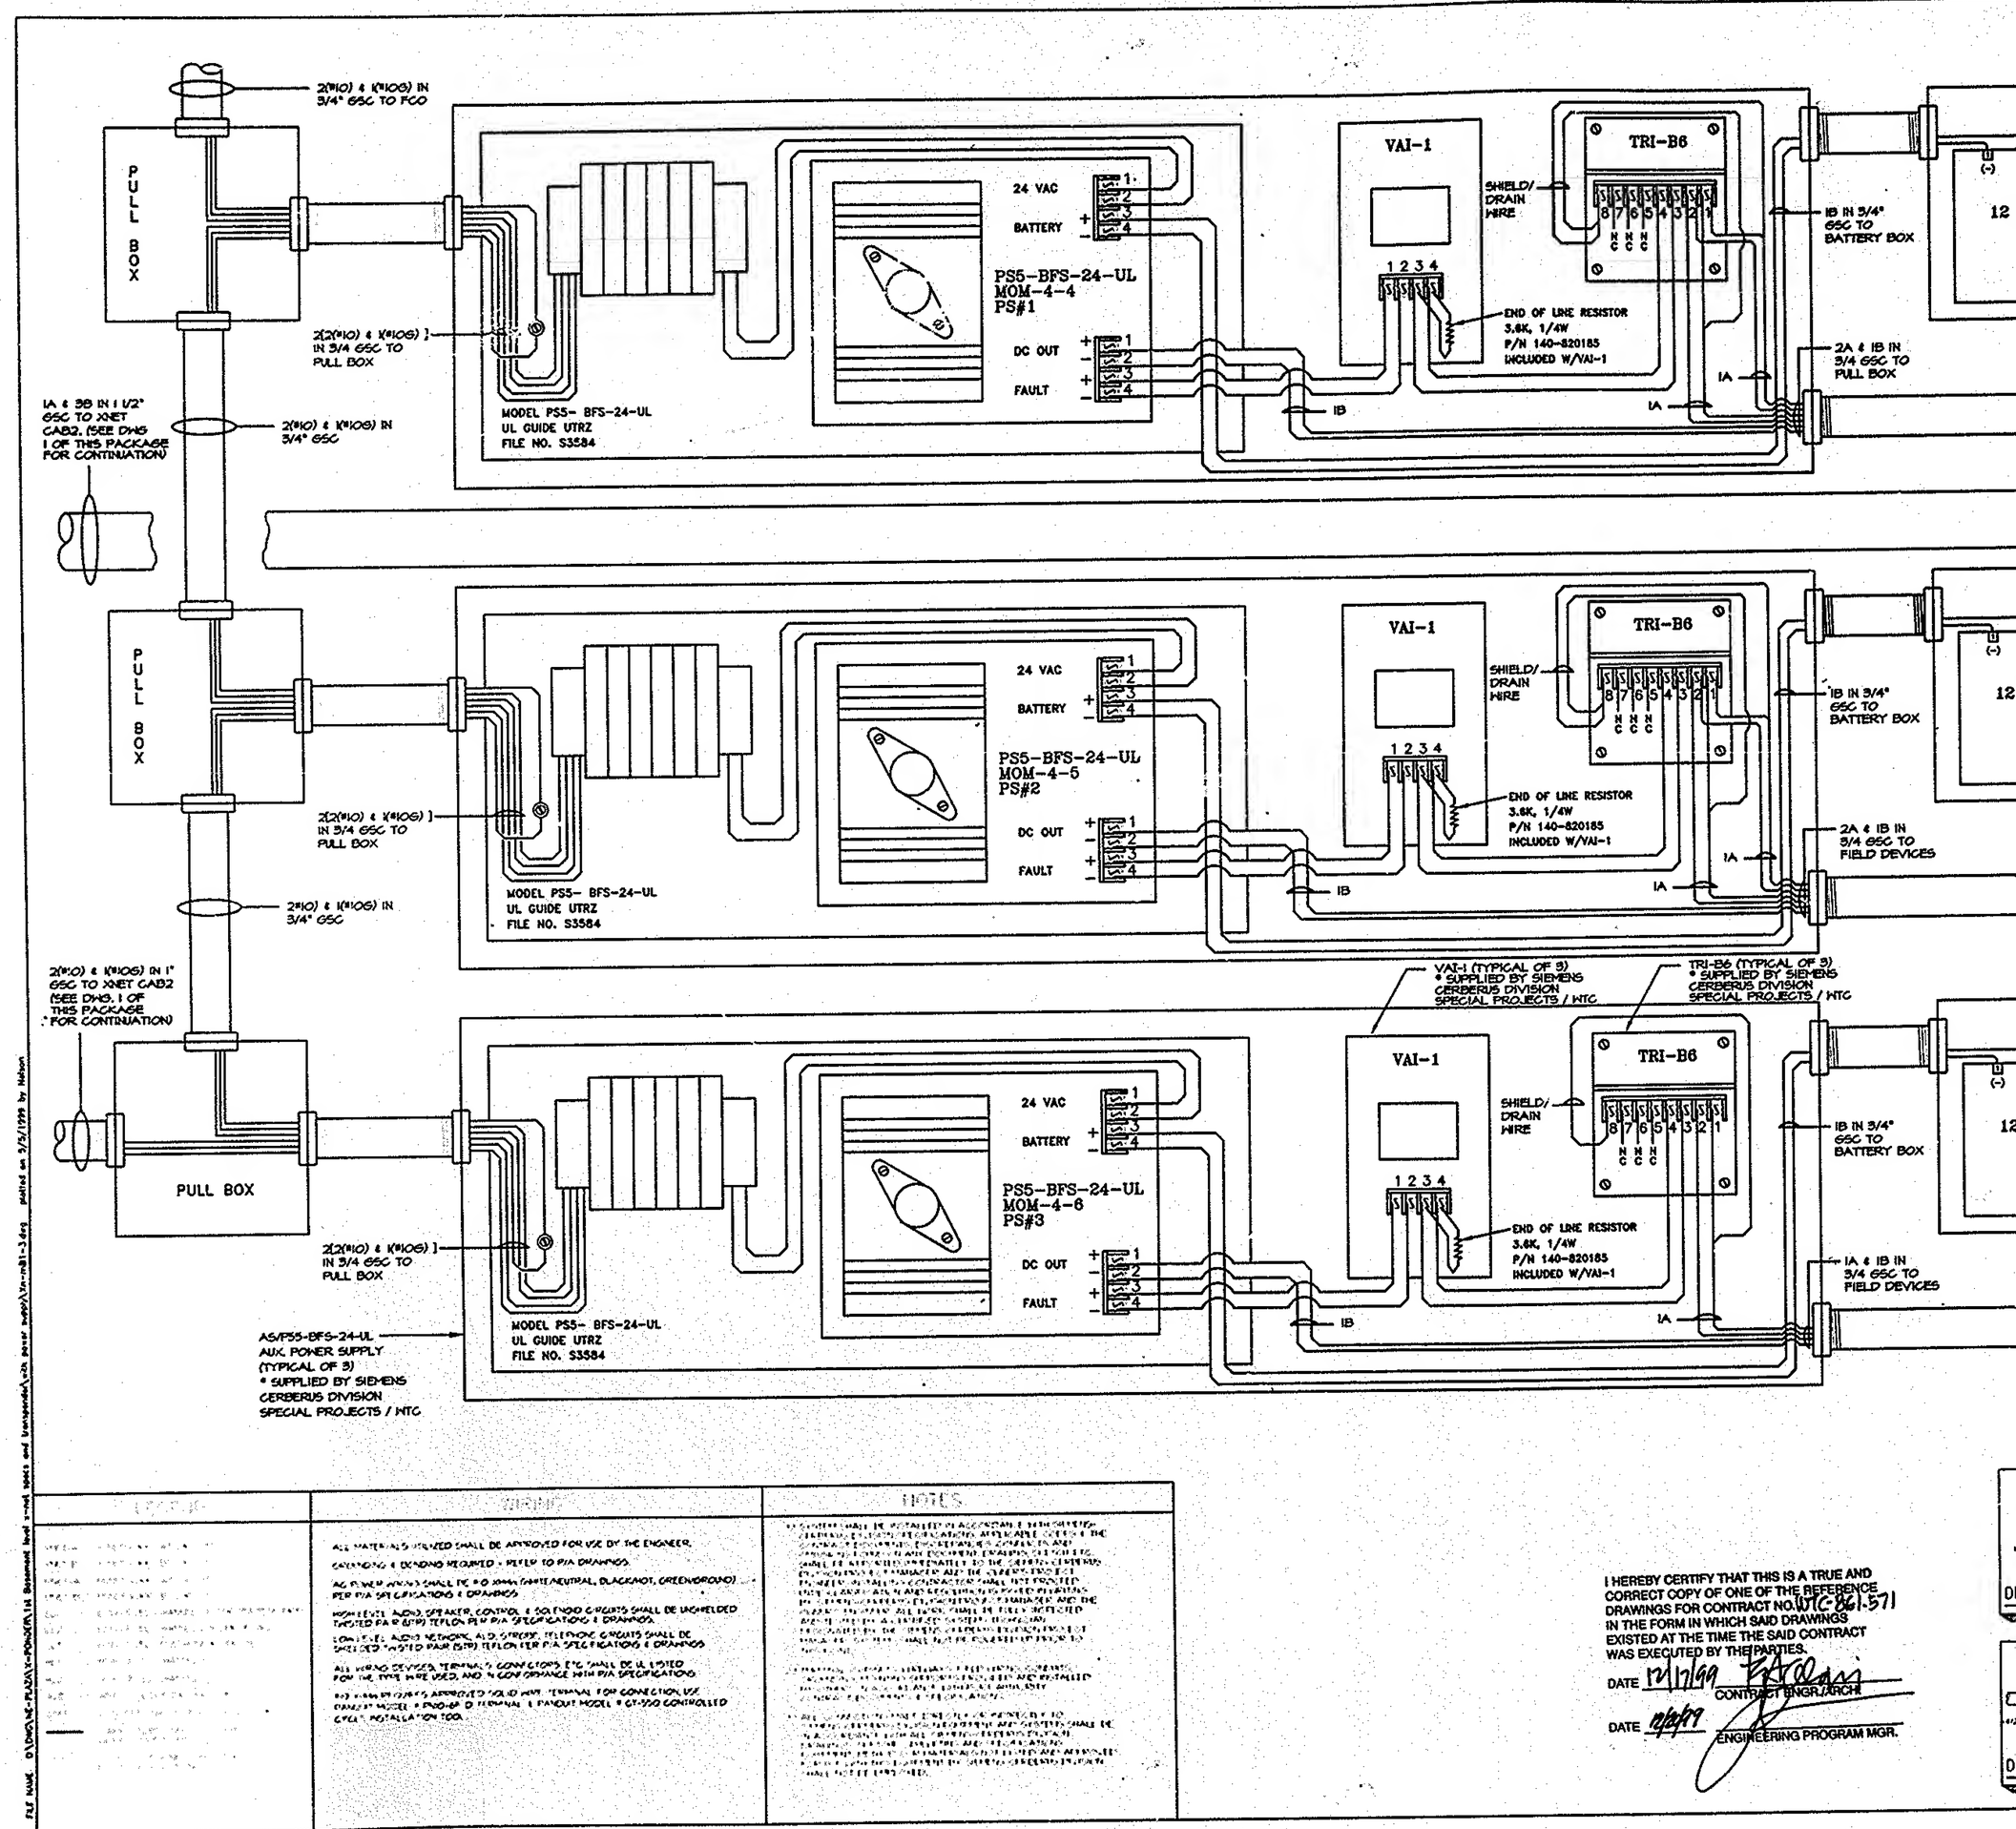

LEGEND	GENERAL	NOTES
	ALL MATERIALS UTILIZED SHALL BE APPROVED FOR USE BY THE ENGINEER. GROUNDING & BONDING REQUIRED - REFER TO P/A DRAWINGS. AC POWER WIRING SHALL BE #12 MIN. (WHITE-NEUTRAL, BLACK-HOT, GREEN-GROUND) PER P/A SPECIFICATIONS & DRAWINGS. HIGH LEVEL AUDIO, SPEAKER, CONTROL & SOLENOID CIRCUITS SHALL BE UNSHIELDED TWISTED PAIR (UTP) TEFLON PER P/A SPECIFICATIONS & DRAWINGS. LOW LEVEL AUDIO NETWORK, A/D, STROBE, TELEPHONE CIRCUITS SHALL BE SHIELDED TWISTED PAIR (STP) TEFLON PER P/A SPECIFICATIONS & DRAWINGS. ALL WIRING DEVICES, TERMINALS, CONNECTORS ETC. SHALL BE UL LISTED FOR THE TYPE WIRE USED, AND IN COMPLIANCE WITH P/A SPECIFICATIONS. NO MORE THAN TWO (2) #12 AWG SOLID WIRE TERMINAL FOR CONNECTION USE DANIELS MODEL # PHDMP-D TERMINAL & PANDUIT MODEL # GT-900 CONTROLLED CYCLE INSTALLATION TOOL.	1. SYSTEM SHALL BE INSTALLED IN ACCORDANCE WITH SPECIFIC REQUIREMENTS, APPLICABLE CODES & THE LATEST EDITION OF NFPA 72 AND ANSI/EIA/TIA 570 AND ANY EXCEPTIONS OR VARIANCES SHALL BE APPROVED IN WRITING BY THE AUTHORITY HAVING JURISDICTION PRIOR TO INSTALLATION. ALL EQUIPMENT & MATERIALS SHALL BE NEW AND UNUSED. CONTRACTOR SHALL NOT PROCEED WITH ANY WORK AS LONG AS ANY DISCREPANCIES EXIST BETWEEN THE CONTRACT DOCUMENTS, FIELD CONDITIONS, OR APPLICABLE CODES. ALL WORK SHALL BE PERFORMED IN A NEAT AND WORKMANLIKE MANNER AND THE SYSTEM SHALL BE LEFT IN FULLY OPERATIVE CONDITION. ALL WORK SHALL BE INSPECTED AND TESTED BY THE INSTALLING CONTRACTOR AND THE RESULTS OF SUCH INSPECTION AND TESTING SHALL BE DOCUMENTED PRIOR TO REQUESTING FINAL INSPECTION BY THE AUTHORITY HAVING JURISDICTION. 2. [illegible] EQUIPMENT AND MATERIALS SHALL BE INSTALLED AND INSTALLED IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS. 3. ALL [illegible] SHALL BE [illegible] SHALL BE [illegible]

I HEREBY CERTIFY THAT THIS IS A TRUE AND CORRECT COPY OF ONE OF THE REFERENCE DRAWINGS FOR CONTRACT NO. UTC-861-571 IN THE FORM IN WHICH SAID DRAWINGS EXISTED AT THE TIME THE SAID CONTRACT WAS EXECUTED BY THE PARTIES.

DATE 12/17/99 CONTRACT ENGR./ARCH.

DATE 12/17/99 ENGINEERING PROGRAM MGR.

FILE NAME: D:\DRAWINGS-PLOTS\X-MONDEX\1A Basement level x-net specs and transponder\2a power supply\2a-ps11-3.dwg plotted on 3/5/1999 by Nelson